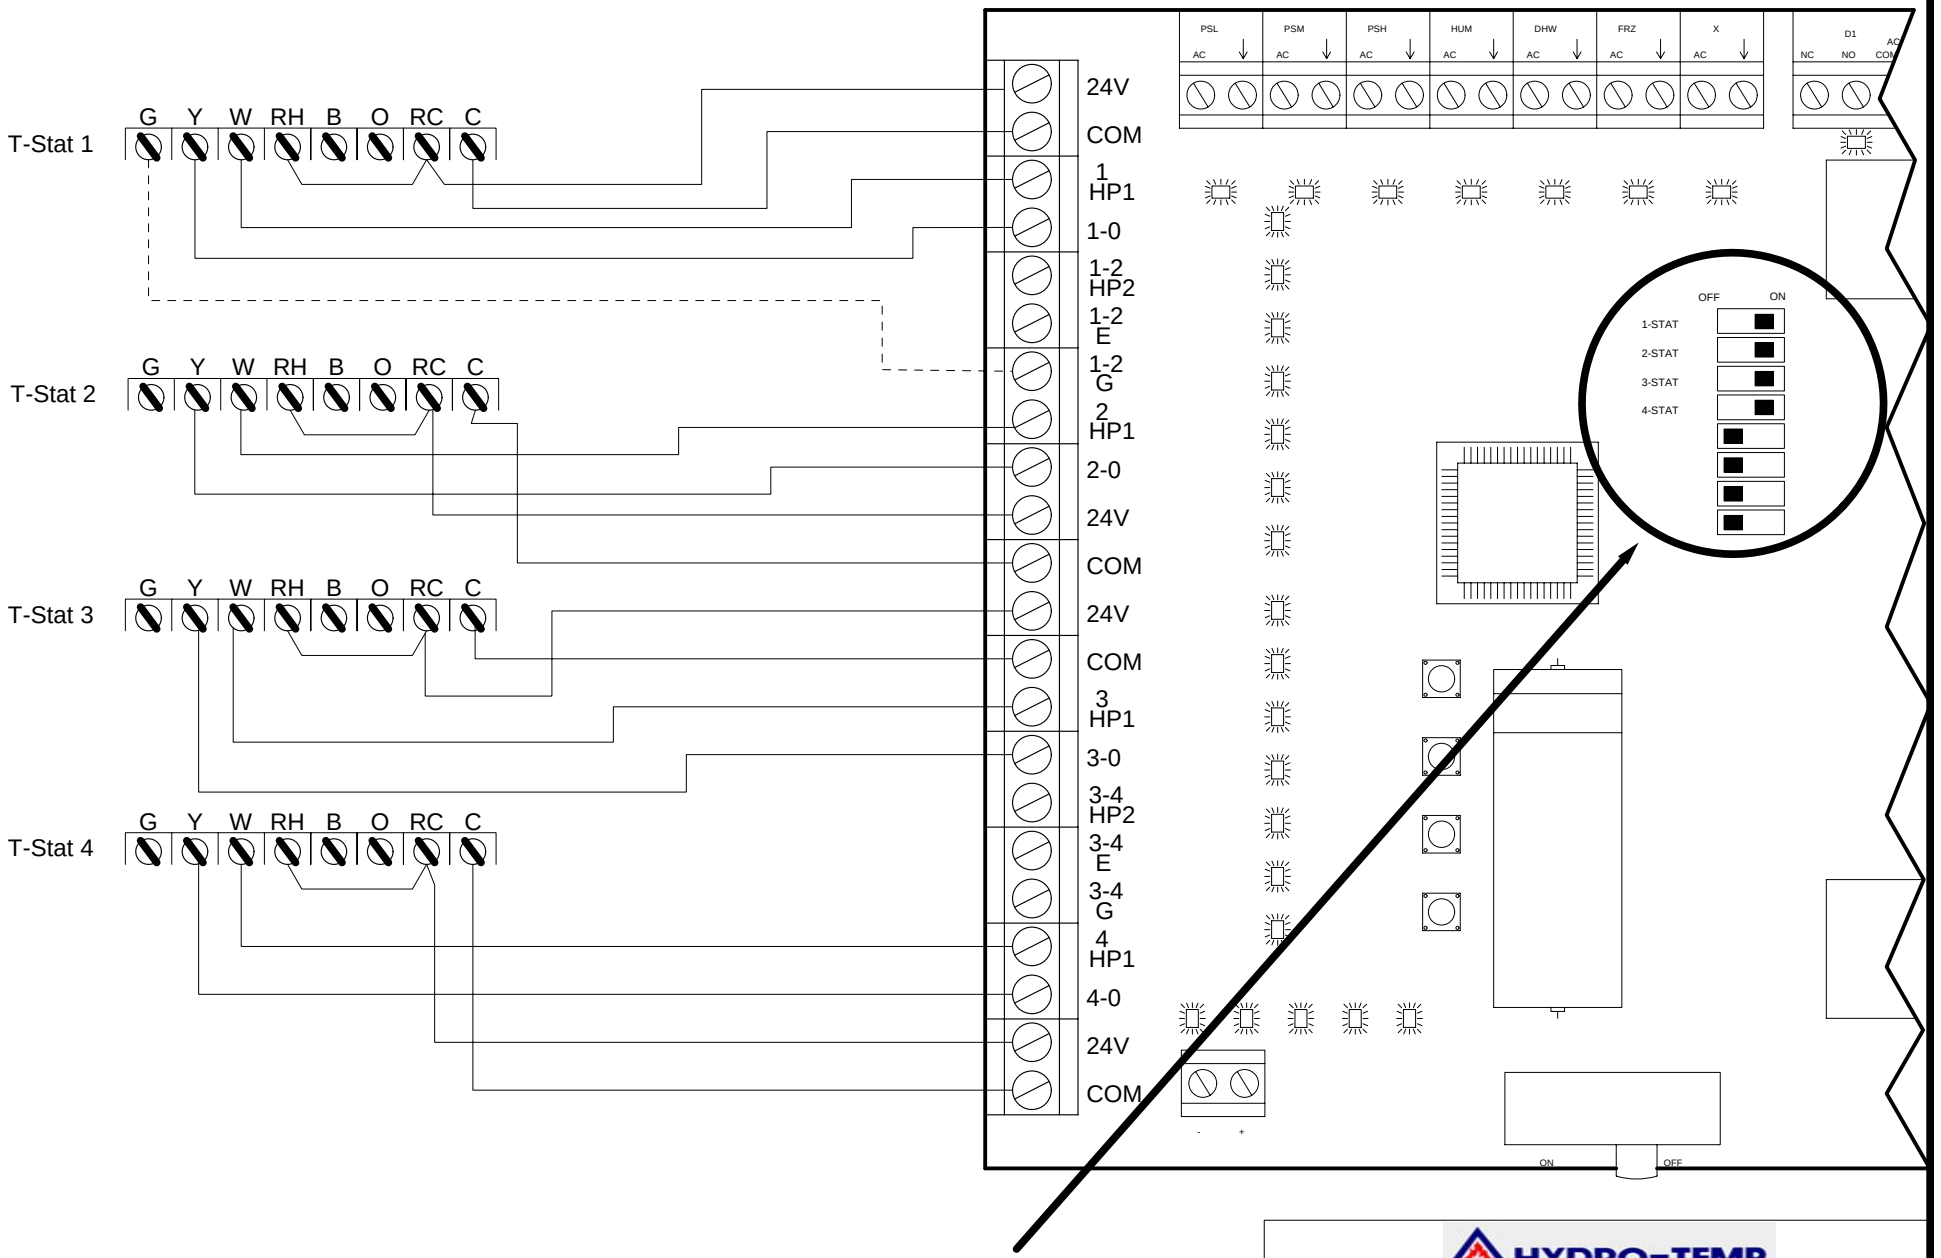

* TURN ON DIPSWITCH ON CONTROL BOARD FOR EACH ZONE WITH LUX 511 T-STAT

**Optional Continuous circulation mode: Only one G line can be Connected to the Microprocessor from any of the 4 thermostats.

IMPORTANT: Connecting a wire to the G terminal on more than one thermostat will cause serious feed back and improper operation.

HYDRO-TEMP
Earth Coupled Heat Pumps

Title	LuxPro PSP511 or other non heat pump Thermostat				
Project	Wiring Diagram			Units	Inches

THIS DRAWING, THE DESIGN AND DEVELOPMENTS ARE THE PROPERTY OF AND ARE NOT TO BE USED OR REPRODUCED IN ANY WAY WITHOUT WRITTEN CONSENT OF HYDRO-TEMP LTD.

DR. BY	HG	DATE	02/15/2002	SCALE	DWG. NO.	REV
Rev.	JR	DATE	01/04/2007	1:1	H001948	1