





Input from City water supply to provide positive water pressure at all times.
 Check valves only required as per local water codes.

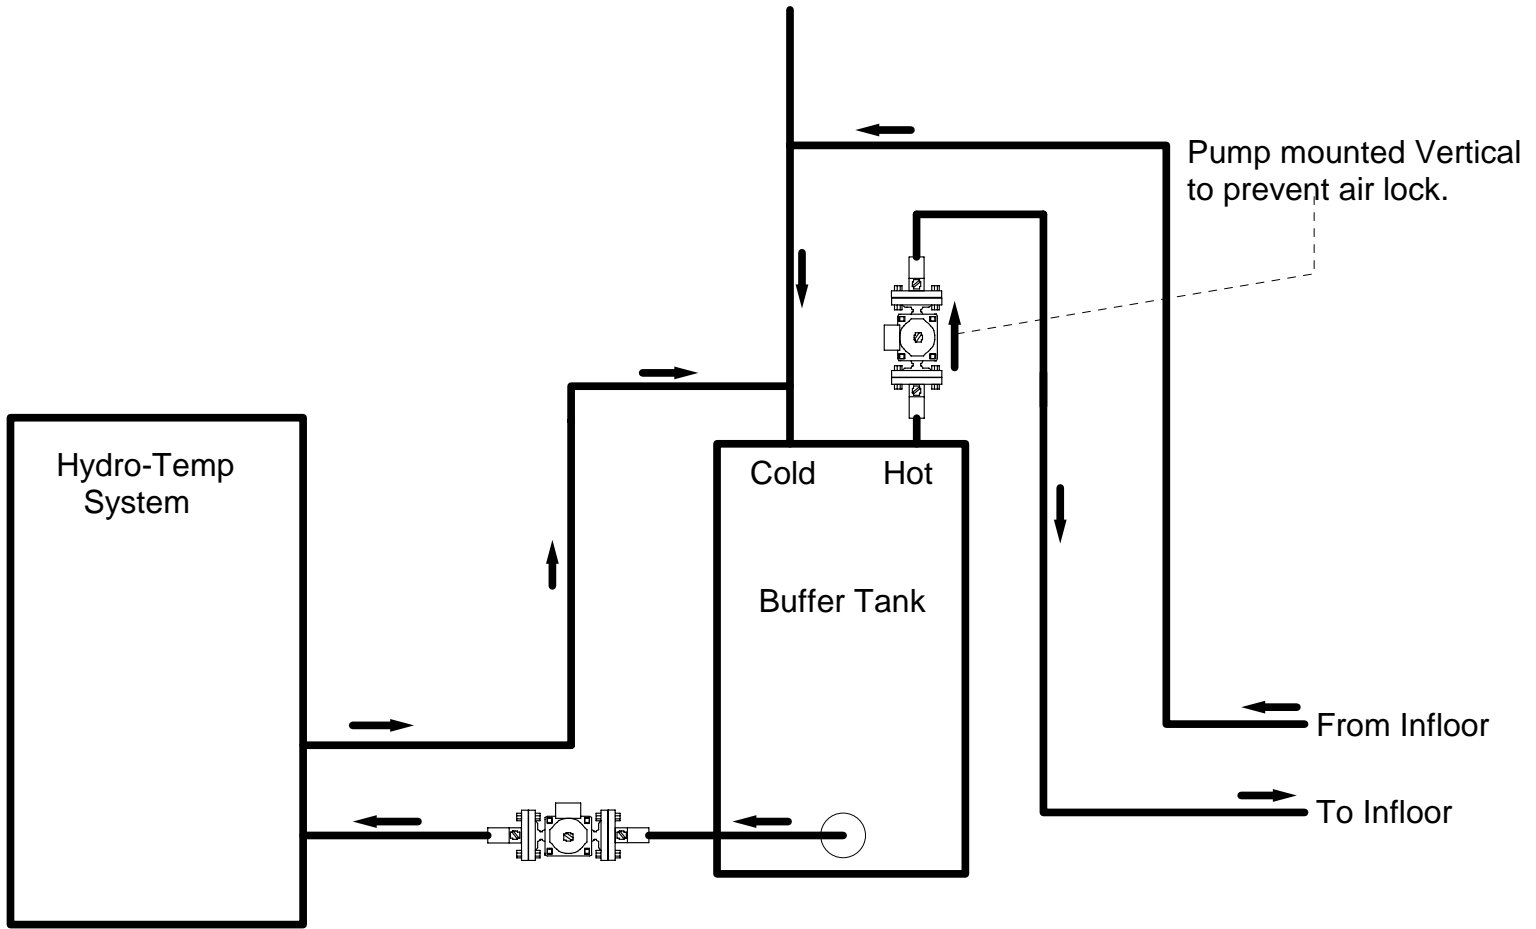

CC1 = Stage 1 Compressor Contactor
 CC2 = Stage 2 Compressor Contactor
 SHC = Aux heat strip Contactor
 SV1 = Water solinoid Valve
 R1 = Blower Relay
 R2 = Loop pump Relay
 R3 = Priority Relay
 RV = Reversing Valve
 TS = Toggle Switch
 HP = High pressure switch
 LP = Low pressure switch
 DOB = Delay on Break
 DOM = Delay on Make
 TL1 = DHW Temperature Limit
 TL2 = Aux. Heat Temp Limit

		
Title <h2 style="margin: 0;">Infloor Plumbing</h2>		
THIS DRAWING, THE DESIGN AND DEVELOPMENTS ARE THE PROPERTY OF AND ARE NOT TO BE USED OR REPRODUCED IN ANY WAY WITHOUT WRITTEN CONSENT OF HYDRO-TEMP LTD.		
DWG Date: <h3 style="margin: 0;">1-16-06</h3>	DWG. NO. <h3 style="margin: 0;">H003629</h3>	REV <h3 style="margin: 0;">1</h3>